


Service Parts Information


DGPC-01-**-51

DGPC-06-**-51

MODEL CODE BREAKDOWN

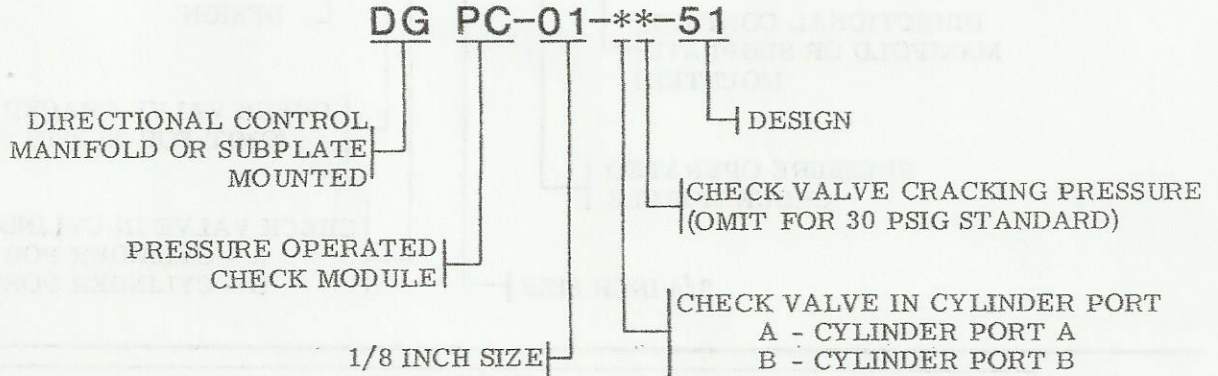


NOTE
 DGPC-01-A*-51 VALVE SHOWN. FOR DGPC-01-B*-51 VALVES, CHECK VALVE PARTS AND PLUG ARE ASSEMBLED ON OPPOSITE ENDS OF VALVE.

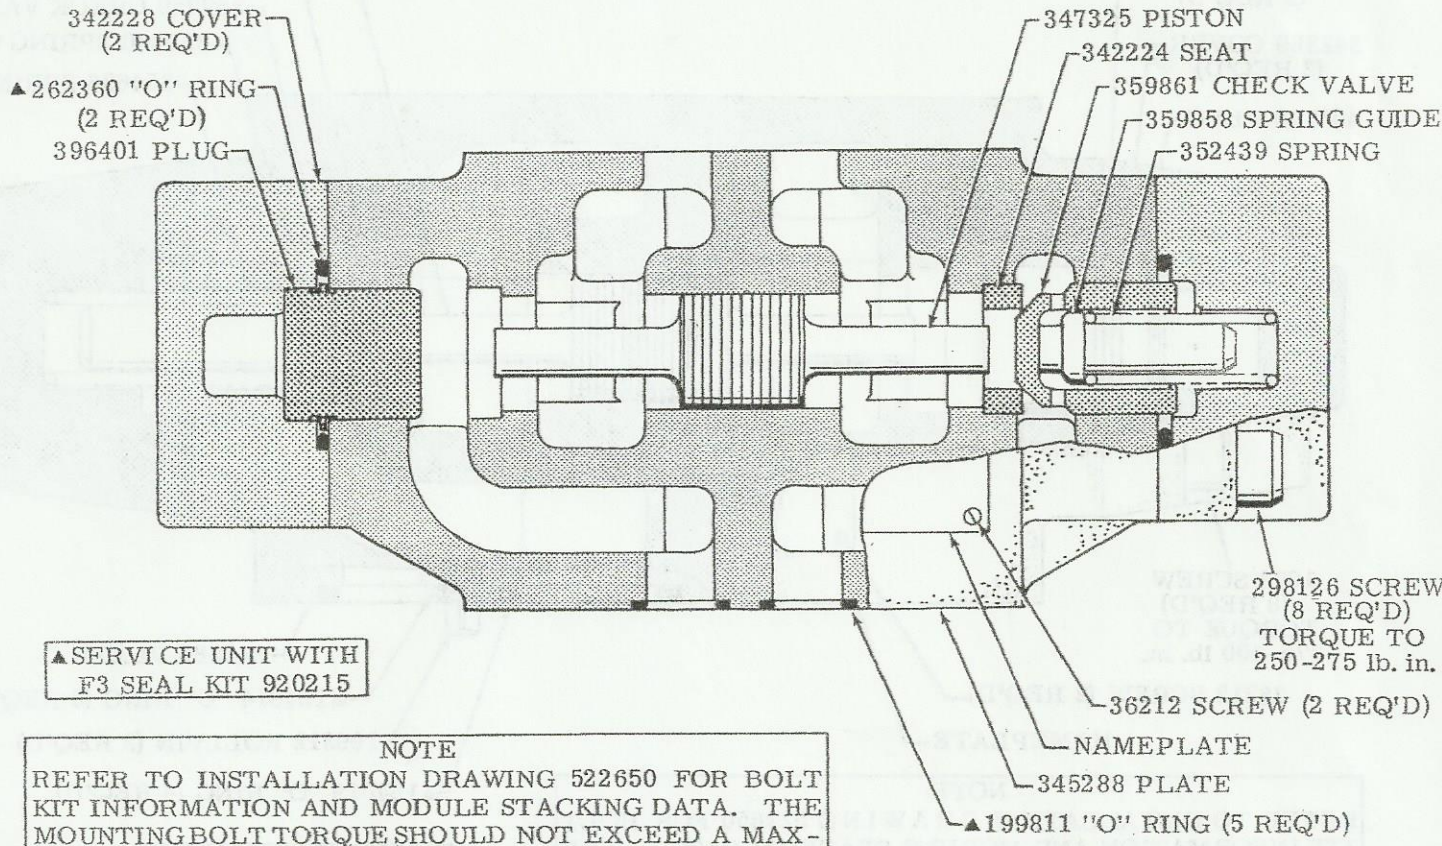


NOTE
 REFER TO INSTALLATION DRAWING 522650 FOR BOLT KIT INFORMATION AND MODULE STACKING DATA. THE MOUNTING BOLT TORQUE SHOULD NOT EXCEED A MAXIMUM OF 112 lb. in.

MODEL CODE BREAKDOWN

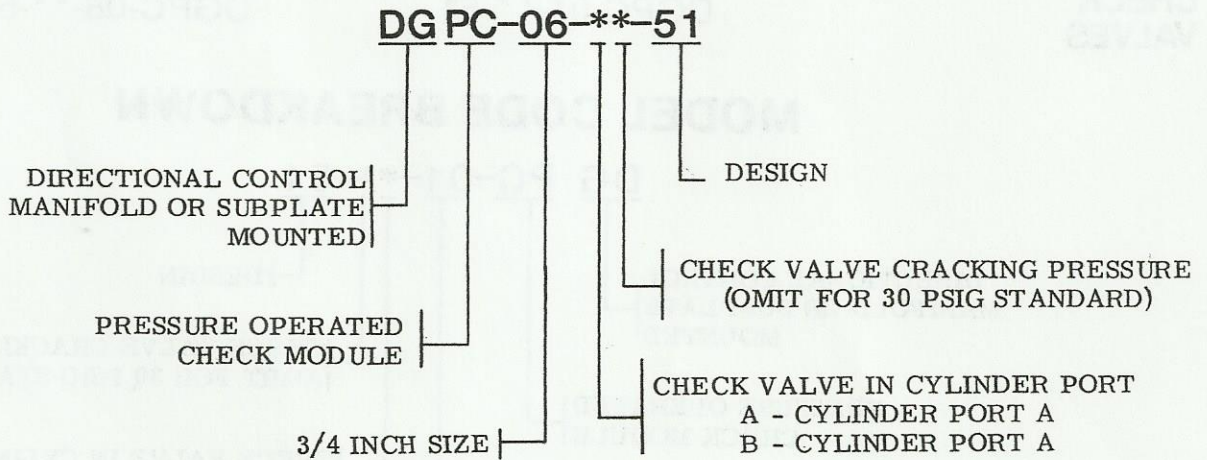

NOTE
DGPC-06-A*-51 VALVE SHOWN. FOR DGPC-06-B*-51 VALVES, CHECK VALVE PARTS AND PLUG ARE ASSEMBLED ON OPPOSITE ENDS OF VALVE.

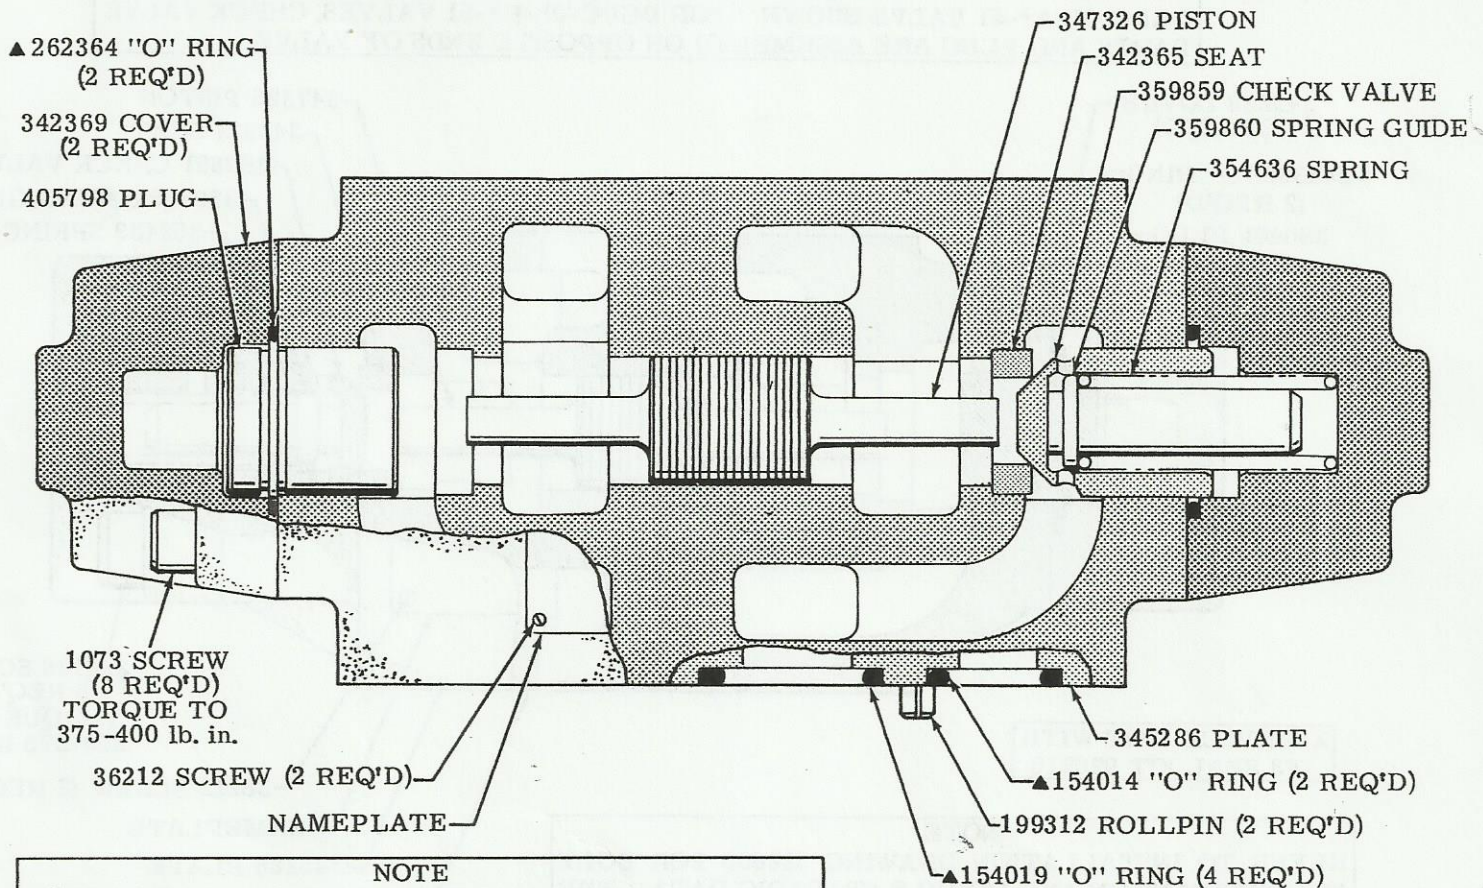

NOTE
REFER TO INSTALLATION DRAWING 522650 FOR BOLT KIT INFORMATION AND MODULE STACKING DATA. THE MOUNTING BOLT TORQUE SHOULD NOT EXCEED A MAXIMUM OF 700 lb. in.

▲ SERVICE UNIT WITH
F3 SEAL KIT 920216